


HIGH CURRENT BUSHING ASSEMBLIES SIDEWALL OR COVER MOUNTED

The electrical ratings given are based on use in a liquid filled transformer with the lower end of the bushing under oil level. Bushing is produced of top quality electrical grade wet process porcelain. Gray glaze is standard unless otherwise specified. Nitrile (Buna-N) gasket is standard. For ordering assemblies with the cork and rubber composition gaskets add the suffix "C" to the part number.

Bus-bar and stud are joined to the connector cap by silver brazing.

For mounting in a 3.38" (min.) diameter hole.

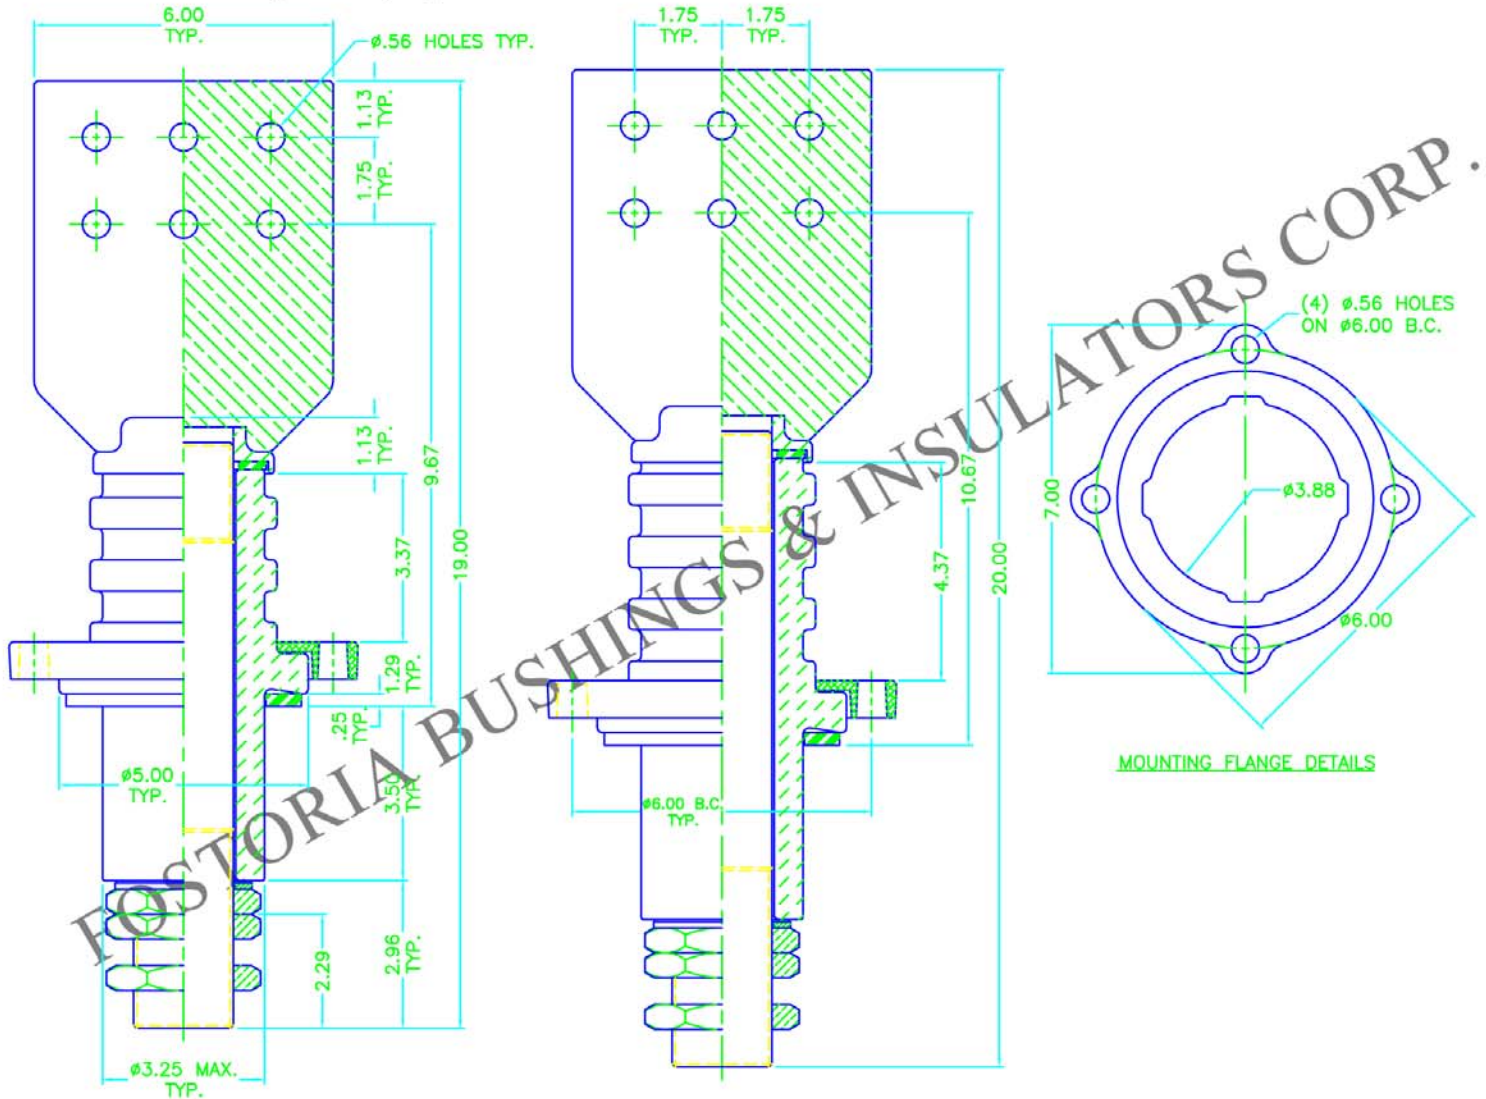

2.5 kV CLASS, 60 kV B.I.L.
4.00" - LEAKAGE DISTANCE

5 kV CLASS, 75 kV B.I.L.
5.00" - LEAKAGE DISTANCE

PART NUMBER	KV CLASS	STUD SIZE	CURRENT RATING	CONNECTOR TYPE
320182	2.5	1.63-12 UN-2A	2000 A	6 HOLE SPADE .50 TK.
320183	2.5	1.63-12 UN-2A	2175 A	6 HOLE SPADE .75 TK.
320184	2.5	1.75-12 UN-2A	2400 A	6 HOLE SPADE .50 TK.
320185	2.5	1.75-12 UN-2A	2600 A	6 HOLE SPADE .75 TK.
320186	2.5	2.00-12 UN-2A	3000 A	6 HOLE SPADE .50 TK.
320187	2.5	2.00-12 UN-2A	3200 A	6 HOLE SPADE .75 TK.
320188	2.5	2.13-12 UN-2A	3200 A	6 HOLE SPADE .50 TK.
320189	2.5	2.13-12 UN-2A	3600 A	6 HOLE SPADE .75 TK.
320282	5	1.63-12 UN-2A	2000 A	6 HOLE SPADE .50 TK.
320283	5	1.63-12 UN-2A	2175 A	6 HOLE SPADE .75 TK.
320284	5	1.75-12 UN-2A	2400 A	6 HOLE SPADE .50 TK.
320285	5	1.75-12 UN-2A	2600 A	6 HOLE SPADE .75 TK.
320286	5	2.00-12 UN-2A	3000 A	6 HOLE SPADE .50 TK.
320287	5	2.00-12 UN-2A	3200 A	6 HOLE SPADE .75 TK.
320288	5	2.13-12 UN-2A	3200 A	6 HOLE SPADE .50 TK.
320289	5	2.13-12 UN-2A	3600 A	6 HOLE SPADE .75 TK.